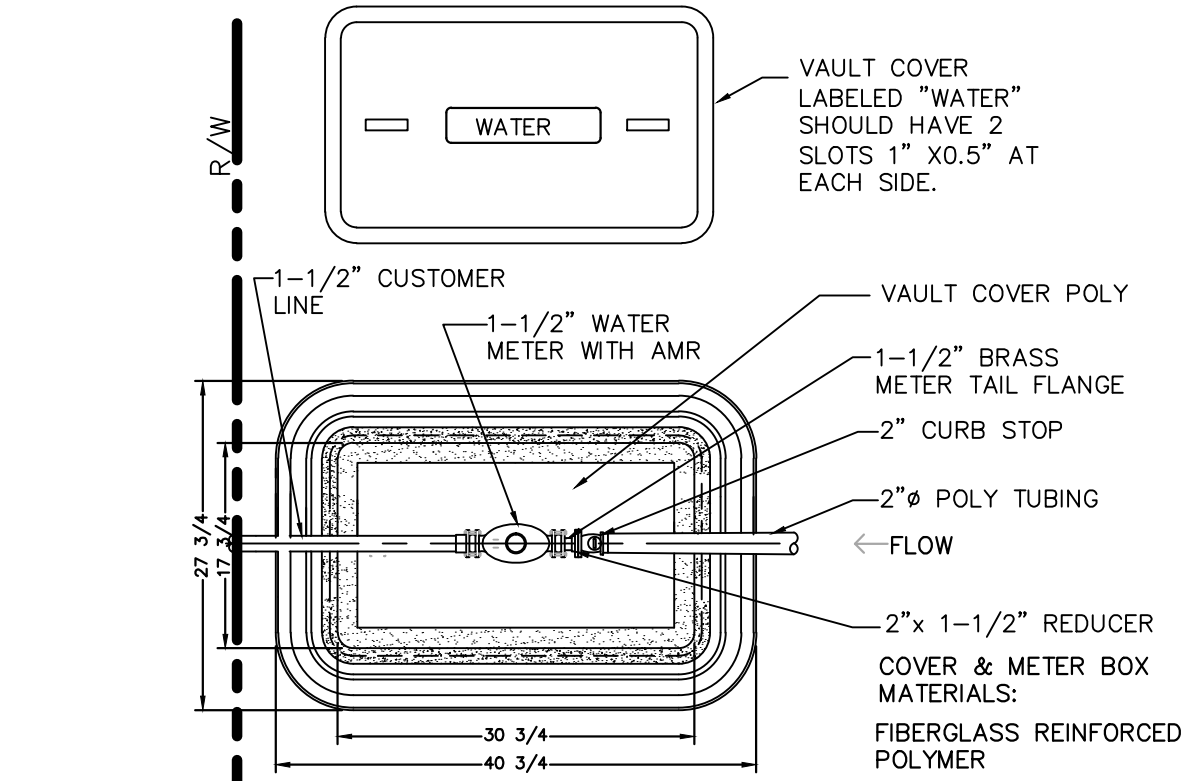

PLAN
N.T.S.

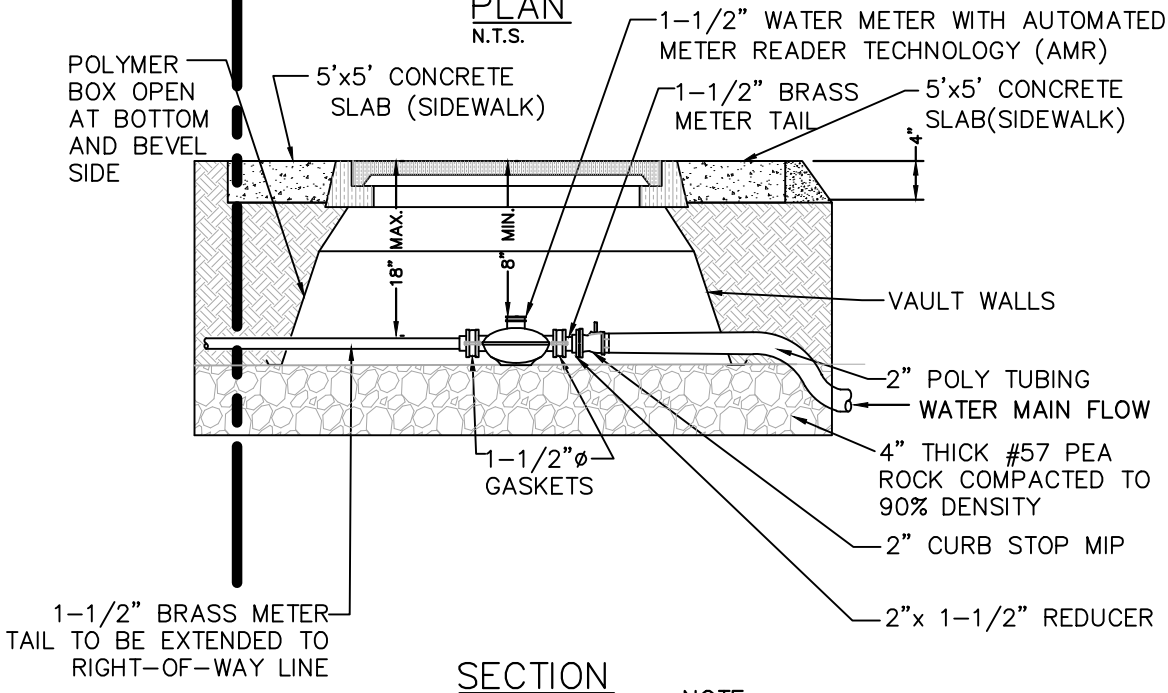

SECTION
N.T.S.

NOTE:
1. METER BOX AND COVER IN TRAFFIC ARE TO BE HS-20 RATED.
2. ALL BRASS FITTINGS TO BE LEAD-FREE MATERIAL.
3. BOLTS TO BE STAINLESS STEEL. NUTS TO BE BRASS.

1-1/2" WATER METER DETAIL
N.T.S.

F:\WORK\$ALL\CAD-DWG\STANDARDS\CMB_ STANDARD_DETAILS\Public Works Manual\CMB Water Details

MIAMIBEACH PUBLIC WORKS DEPARTMENT 1700 CONVENTION CENTER DRIVE, MIAMI BEACH, FL.33139	APPROVED 9/2014	REVISED 08/06/2010 01/21/2011 02/16/2012 07/11/2012 07/01/2013 08/13/2013 09/04/2014	TITLE: WATER DETAILS NO. 2 1 - 1/2" WATER METER DETAIL	WS13